

Performance Compliance Report

Non-Transferable

Aluminium System Distributor


Alsysco
Postnet Suite 174
Private Bag X592
PRETORIA
0127

PCR096

Method of Glazing

Channel Gasket

Elevation & Dimensions of Test Unit

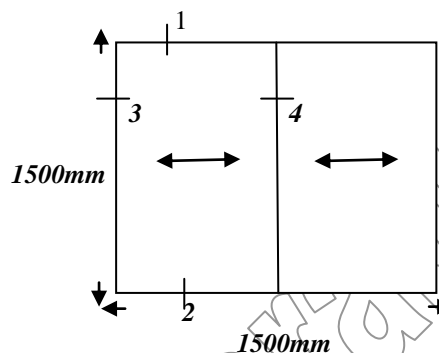

Glass Types

4mm toughened safety glass

Extrusions used in manufacture

<i>Detail #</i>	<i>Reference #</i>	<i>Description</i>
1	ALA500-FHS/ALA500-SHS	Head & Sash
2	ALA500-FHS/ALA500-SHS +ALFB38x15	Cill, sash & adaptor
3	ALA500-FJ/ALA500-HSJ	Jamb & Sash
4	2 x ALA500I	Interlock
Throughout	AHWP-6.7 x 6mm	Weatherseal
Throughout	ALSVG 01 & 02	4mm channel

Test Results

Negative Pressure 1500Pa – deflection 8.57mm
Positive Pressure 1500Pa – deflection 8.57mm
Water Penetration No leakage at 300Pa
Structural Pressure 2250Pa
Air infiltration 0.05 l/s/m²

AAAMSA Standard Achieved

A2

Comment

When manufactured to recommendations stipulated by the system provider, the **Sliding Window** is able to pass performance criteria **A2** as laid down in AAAMSA's General Specification for aluminium and glass products.

Each individual manufacturer must obtain appropriate AAAMSA Performance Test Certificate to confirm his ability to conform to this Performance Compliance Report. D0843

*This document is to be read in conjunction with the appropriate technical and assembly documentation supplied by **Messrs. Alsysco***

Issued: 25 October 2012


EXECUTIVE DIRECTOR

(For inclusion with Form 1 of SANS 10400-A)