

# Performance Compliance Report

Non-Transferable

Aluminium System Distributor

Alsysco  
Postnet Suite 174  
Private Bag X592  
PRETORIA  
0127

PCR132  
Rev. 1




Reg.No.1974/000006/08  
Association NPC  
VAT No. 4900141153

+27(0)11 805-5002  
elize@aaamsa.co.za

Method of Glazing

Channel Gasket

Elevation & Dimensions of Test Unit

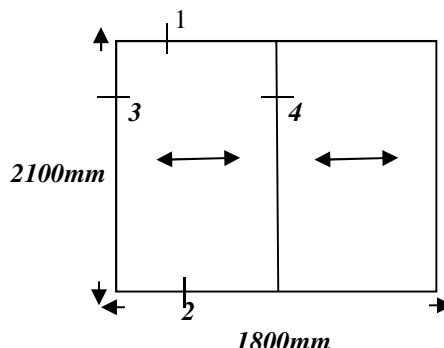

Glass Types

6mm toughened safety glass

Extrusions used in manufacture

Detail #	Reference #	Description
1 & 2	AEA/DK/FHS	Frame Head & Sill
1 & 2	AEA/DK/SHS	Wheel Sash Head & Sill
3	AEA/DK/FJ-AEA/DK/LS	Jamb and lock stile
4	AEA/DK/RI	Interlocker
Throughout	AHGK/004C	Channel Gasket
Throughout	AHWP/FP6 7 x 6	Finpile

Test Results

Negative Pressure 2000Pa – deflection 12mm  
Positive Pressure 2000Pa – deflection 12mm  
Water Penetration No leakage at 400Pa  
Structural Pressure 3000Pa  
Air infiltration 0.01 l/s/m<sup>2</sup>

AAAMSA Standard Achieved

A3

Comment

When manufactured to recommendations stipulated by the system provider, the **Knysna Sliding door** is able to pass performance criteria **A3** as laid down in AAAMSA's General Specification for aluminium and glass products.

*Each individual manufacturer must obtain appropriate AAAMSA Performance Test Certificate to confirm his ability to conform to this Performance Compliance Report. B2167*

**This document is to be read in conjunction with the appropriate technical and assembly documentation supplied by Messrs. Alsysco**

Issued: 04 September 2019

EXECUTIVE DIRECTOR

(For inclusion with Form 1 of SANS 10400-A)

